


CWT-M6

Modbus IO module

Hardware Manual

1 Size



2 Hardware Description

2.1 LED indicator description




Indicator	Status	means
BAT (Green)	reserve	reserve
NET (Red)	reserve	reserve
ACT (Yellow)	reserve	reserve
SRV (Orange)	On	Starting
	Off	Starting complete

2.2 Antenna

Standard SMA female interface (50Ω)

2.3 Wiring terminal

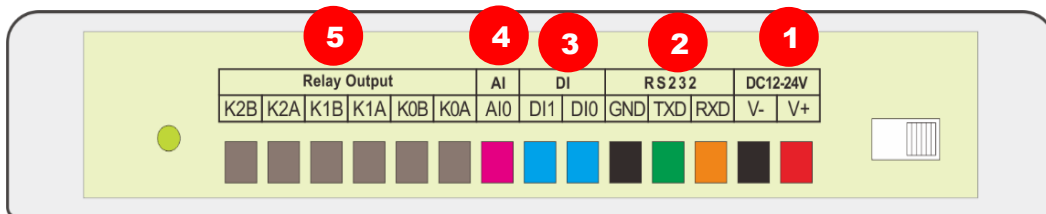

Terminal specification: 14pin * 3.81mm

① DC12-24V (Power in)


V+ and V- is DC12-24V power in

② RS232

It's configuration port


③ 2 Digital Inputs

dry contact trigger

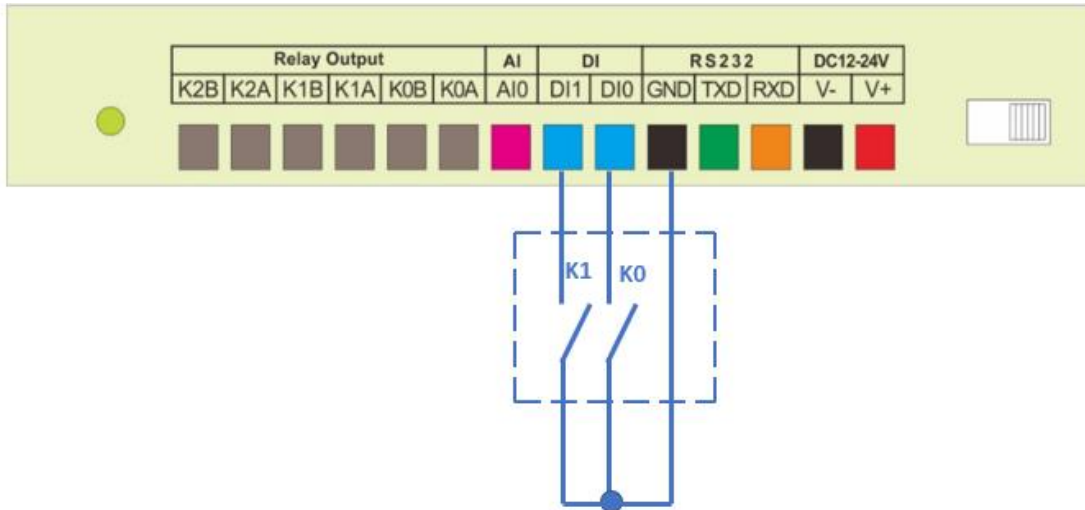

④ 3 Relay Drivable Output

Relay parameters: NO contact, contact load 2A/125VAC, 220VDC

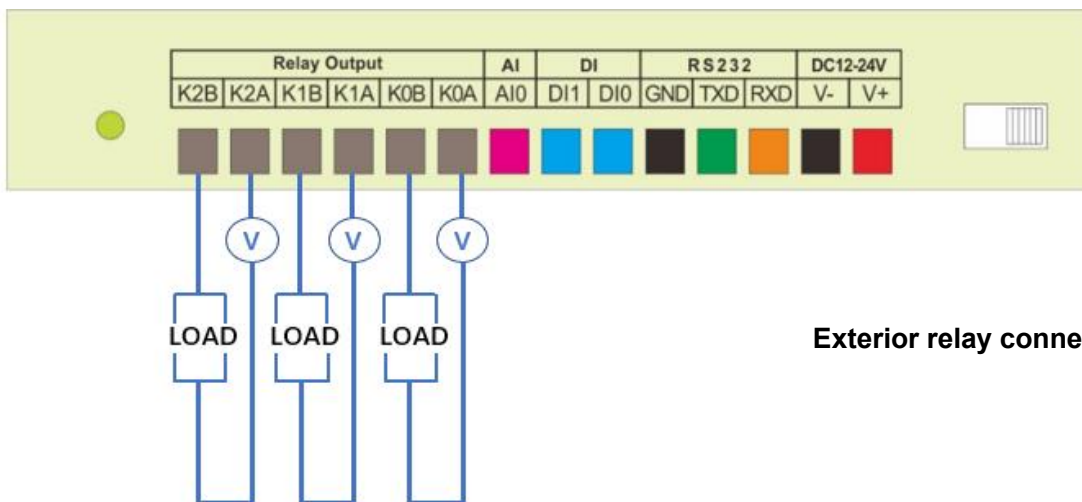

Exterior relay connection

⑤ 1 Analog Inputs

Type: 4 ~ 20mA <default>

